


J45 Rated Firetex Jet Fire Resistant Module Seal System

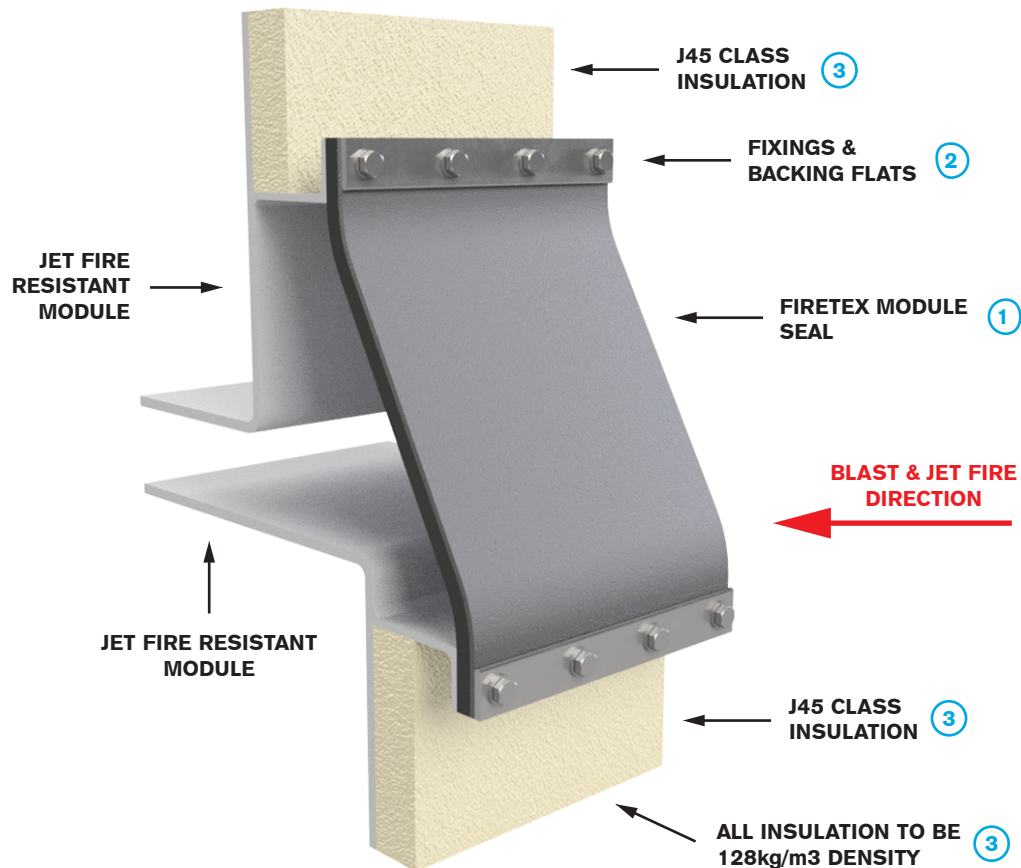

- ① PROVIDED BY MCL UNITEX LTD.
- ② CAN BE PROVIDED ON SPECIAL REQUEST
- ③ PROVIDED BY OTHERS.

www.mclunitex.com

Specification

Certification:	Tested to J45 in accordance with HSE standard OTI 95 634 Lloyds Register of Shipping, Certificate No. SAS F140319. Blast over-pressure to 1.1 bar g, Lloyds Register of Shipping Certificate No. LWT 401087/1.
Insulation:	Insulation in accordance with Lloyds Register of Shipping, Certificate No. SAS F140319.
Movement:	MCL's engineering staff should be consulted for advice.
Installation:	Each seal is supplied with installation instructions.
Location:	Seals to be installed on the hazard side.