


Insulation Requirements for Firetex Single Sided Wrap Around J60 Rated Pipe Penetration Seals

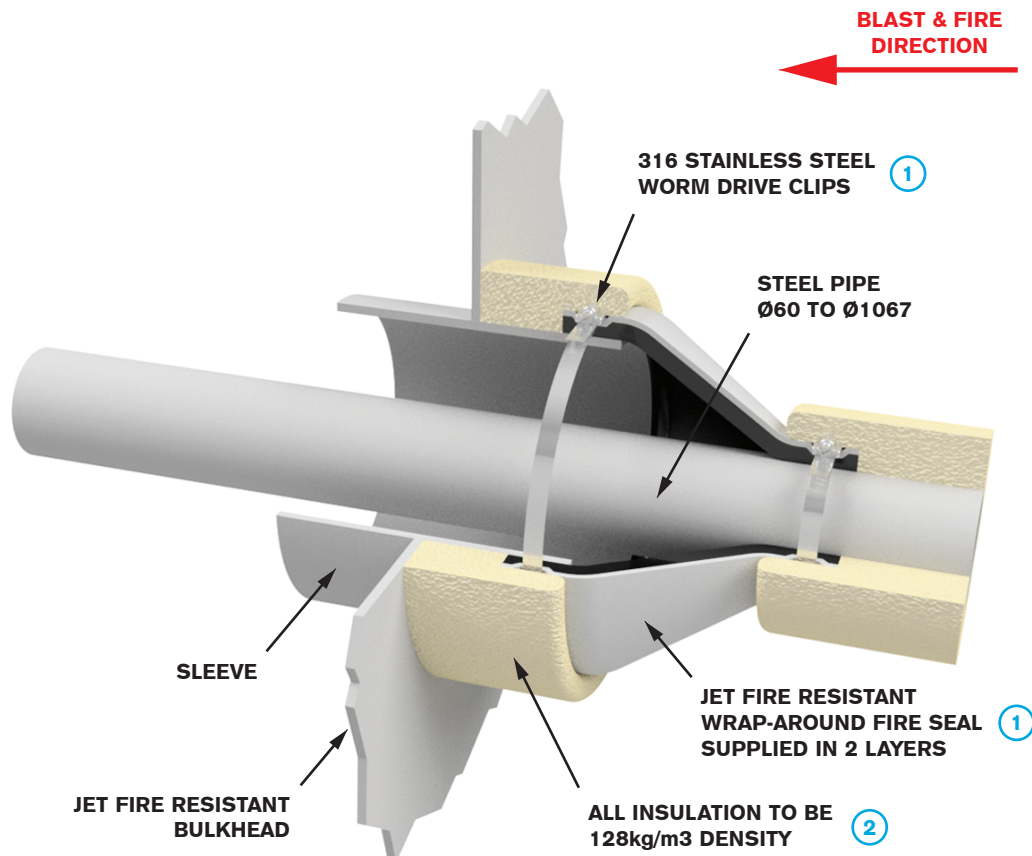

① PROVIDED BY MCL UNITEX LTD.

② CAN BE PROVIDED ON SPECIAL REQUEST

www.mclunitex.com

Specification

Certification:	Tested to J60 in accordance with HSE standard OTI 95 634 Lloyds Register of Shipping, Certificate No. SAS F150138. Blast over-pressure to 1.35 bar g, Lloyds Register of Shipping Certificate No. LWT 401087/1.
Insulation:	Insulation in accordance with Lloyds Register of Shipping, Certificate No. SAS F1501358.
Movement:	Standard seal construction will accommodate +/- 25mm in any plane.
Installation:	Each seal is supplied with installation instructions, sealant and stainless steel worm drive clips.
Location:	Seals to be installed on the hazard side of the penetration.