


## A0 / H0 Rated Firetex Module Seal System

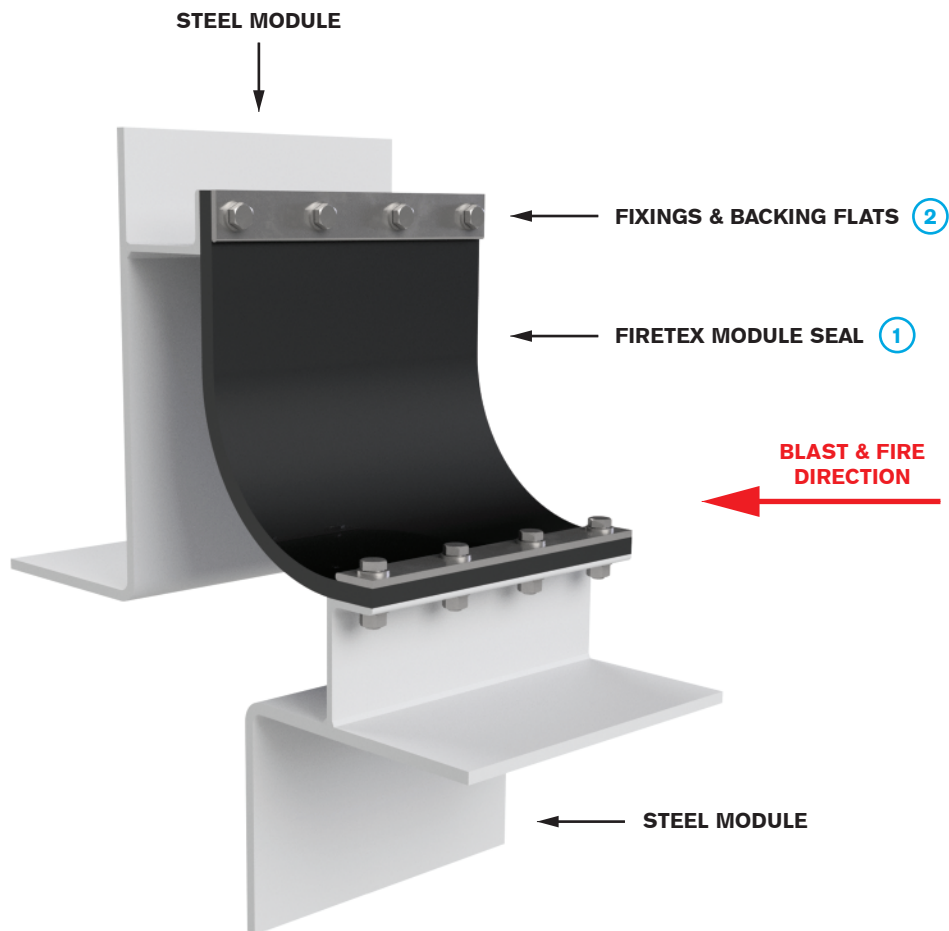

[www.mclunitex.com](http://www.mclunitex.com)

- ① PROVIDED BY MCL UNITEX LTD.
- ② CAN BE PROVIDED ON SPECIAL REQUEST

### Specification

<b>Certification:</b>	A0 and H0 Lloyds Register of Shipping, Certificate No. SAS F150137. Blast over-pressure to 1.1 bar g, Lloyds Register of Shipping Certificate No. LWT 401087/1.
<b>Movement:</b>	MCL's engineering staff should be consulted for advice.
<b>Installation:</b>	Each seal is supplied with installation instructions.
<b>Location:</b>	Seals to be installed on the hazard side.