


## Insulation Requirements for Firetex Single Sided Wrap Around J120 Rated Pipe Penetration Seals

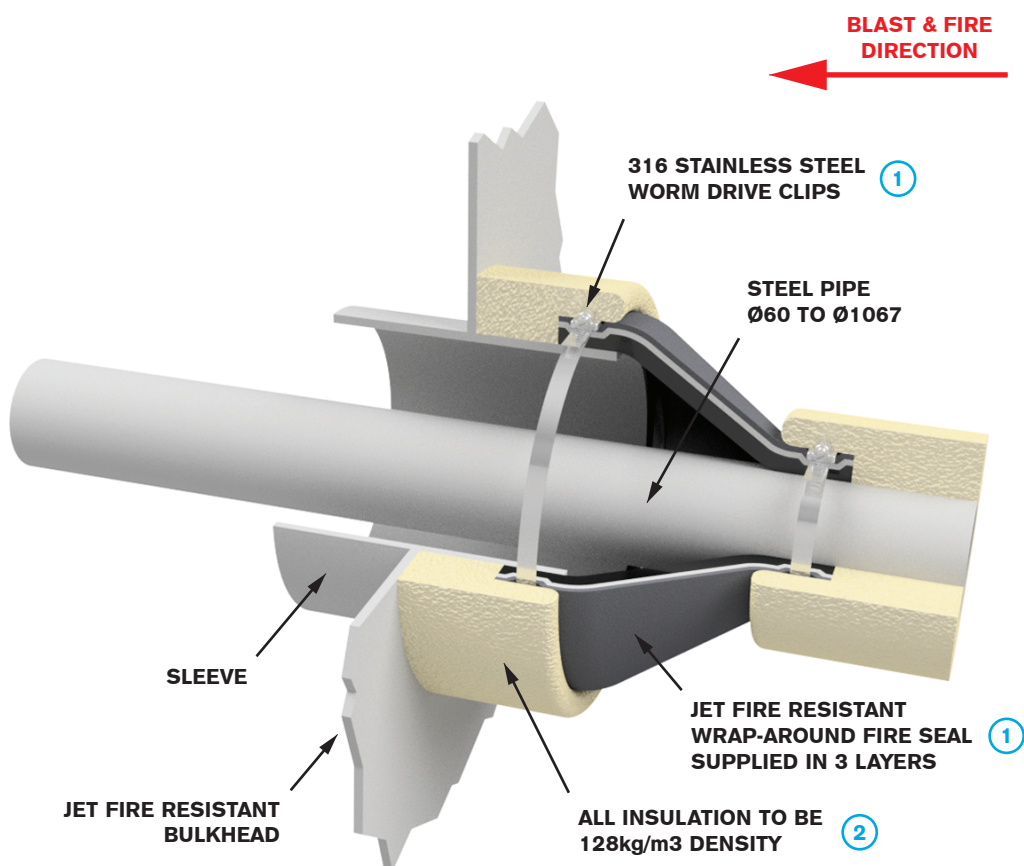

- ① PROVIDED BY MCL UNITEX LTD.  
 ② CAN BE PROVIDED ON SPECIAL REQUEST

[www.mclunitex.com](http://www.mclunitex.com)

### Specification

|                       |  |
|-----------------------|--|
| <b>Certification:</b> | Tested to J120 in accordance with HSE standard OTI 95 634 Lloyds Register of Shipping, Certificate No. SAS F150139. Blast over-pressure to 1.35 bar g, Lloyds Register of Shipping Certificate No. LWT 401087/1. |
| <b>Insulation:</b>    | Insulation in accordance with Lloyds Register of Shipping, Certificate No. SAS F150139.  |
| <b>Movement:</b>      | Standard seal construction will accommodate +/- 25mm in any plane.   |
| <b>Installation:</b>  | Each seal is supplied with installation instructions, sealant and stainless steel worm drive clips.  |
| <b>Location:</b>      | Seals to be installed on the hazard side of the penetration.   |